


PLAN

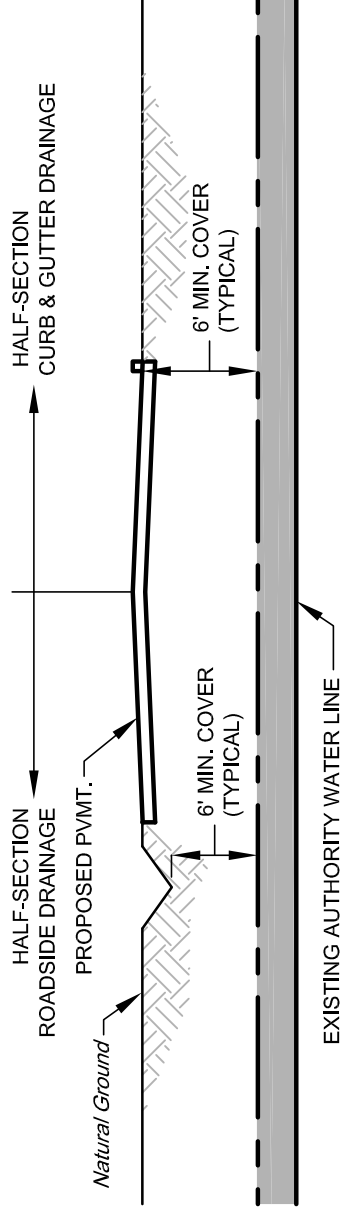

SECTION

NOTES:

1. ANY PROPOSED PAVEMENT, REGARDLESS OF THE TYPE OF MATERIAL, CONSTRUCTED OVER THE EXISTING AUTHORITY'S WATER LINE SHALL AT ALL TIMES MAINTAIN A MINIMUM OF SIX (6) FEET OF COVER FROM TOP OF PAVEMENT TO THE WALL OF THE AUTHORITY'S WATER LINE; ANY DRAINAGE SWALES/DITCHES OR GRADING SHALL MAINTAIN A MINIMUM OF SIX (6) FEET OF COVER FROM BOTTOM OF DRAINAGE TO TOP OF THE EXISTING AUTHORITY WATERLINE.
2. THE ELEVATION OF EXISTING APPURTENANCES CONFLICTING WITH PROPOSED PAVING CONSTRUCTION SHALL BE ADJUSTED UNDER THE DIRECTION OF AUTHORITY'S ENGINEER. CAUTIONARY MEASURES SUCH AS THE PLACEMENT OF BOLLARDS MAY BE REQUIRED.
3. PAVEMENT OVER AUTHORITY FACILITIES SHOULD INCORPORATE CONSTRUCTION JOINTS TO ALLOW FOR MAINTENANCE ACCESS.
4. SEE GENERAL NOTES FOR ADDITIONAL GUIDELINES.



**DANNENBAUM**  
**ENGINEERING CORPORATION**  
 T.B.P.E. FIRM REGISTRATION #392  
 3100 WEST ALABAMA HOUSTON, TX 77088 (713) 520-9570

SURFACE CROSSING  
 GUIDELINES

SCALE: NTS

JOB #: 3487-03

DATE: FEB, 2017